

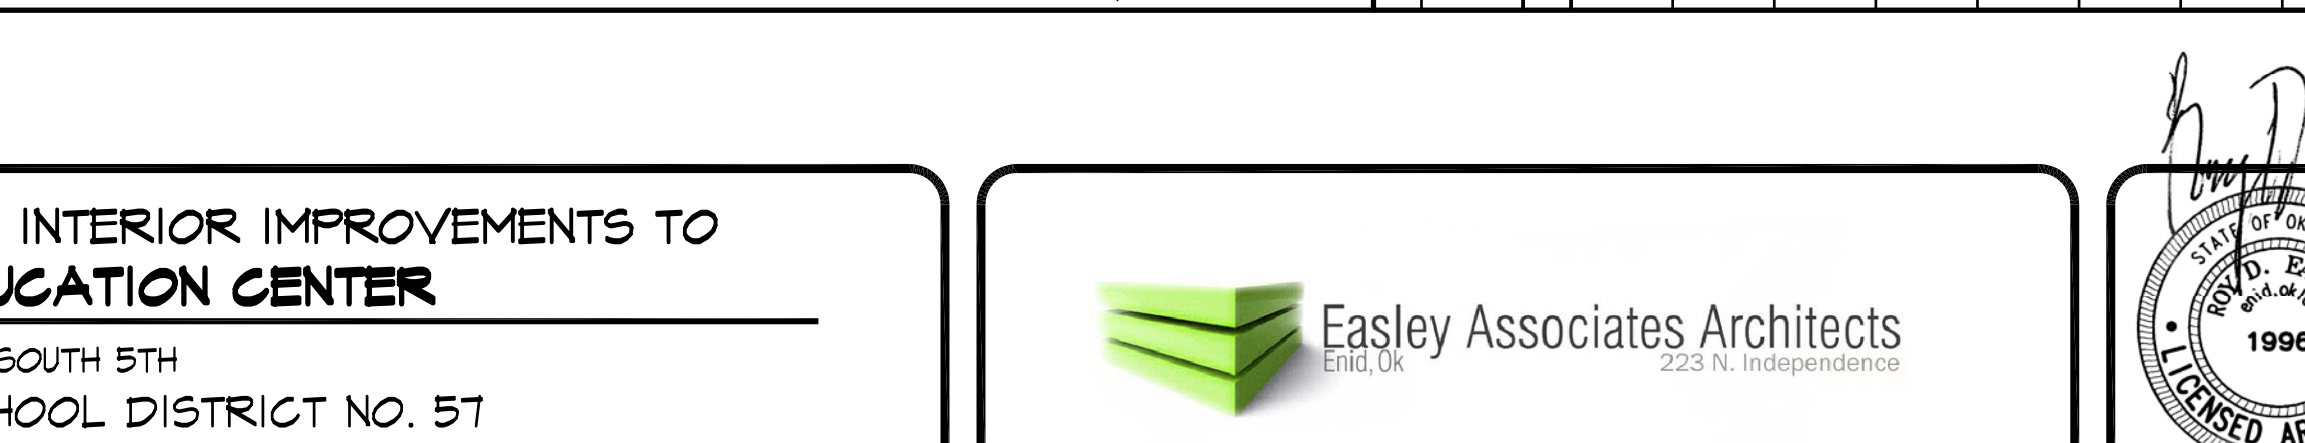


DOOR & GLAZING SCHEDULE

MARK	WINDOW SIZE	FRAME	GLAZING	HEAD	JAMB	SILL	MULLION
A	25'-0" x 6'-2" R.O.	FIXED ALUMINUM W/ 2 SINGLE HING	"1" INSULATING BRONZE TINT W/ SPANDREL TRANSOM	5/10/8	12/9/8	45/5/3	35/5/3
B	4'-0" x 8'-2"	FIXED ALUMINUM	"1" INSULATING BRONZE TINT W/ SPANDREL TRANSOM	5/10/8	2/3	5/3	5/3
C	2'-4" x 4'-6"	FIXED ALUMINUM	"1" INSULATING FROSTED/OBSCURE	5/3	2/3	5/3	5/3
D	3'-4" x 8'-2"	FIXED ALUMINUM	"1" INSULATING FROSTED/OBSCURE "4" INSULATING METAL PANEL	5/3	2/3	5/3	5/3
E	3'-0" x 10'-0"	FIXED ALUMINUM	"1" INSULATING FROSTED/OBSCURE "4" INSULATING METAL PANEL	5/3	2/3	5/3	5/3
F	1'-0" x 1'-2"	FIXED ALUMINUM	"1" METAL INSULATED BRONZE PANEL EMBOSSED	5/3	2/3	5/3	5/3
G	3'-2" x 11'-6" TRANSOM H/M DOOR & FRAME 3'-6" x 8'-0" R.O.	HOLLOW METAL FRAME	"1" METAL INSULATED BRONZE PANEL EMBOSSED	5/3	2/3	5/3	5/3
H	3'-0" x 11'-0" DOOR (3'-6" x 8'-0" R.O.)	DOOR SIZE		HEAD	JAMB	SILL	MULLION
I	3'-0" x 11'-0" DOOR (3'-6" x 8'-0" R.O.)	DOOR SIZE		HEAD	JAMB	SILL	MULLION
J	3'-0" x 11'-0" DOOR (3'-6" x 8'-0" R.O.)	DOOR SIZE		HEAD	JAMB	SILL	MULLION

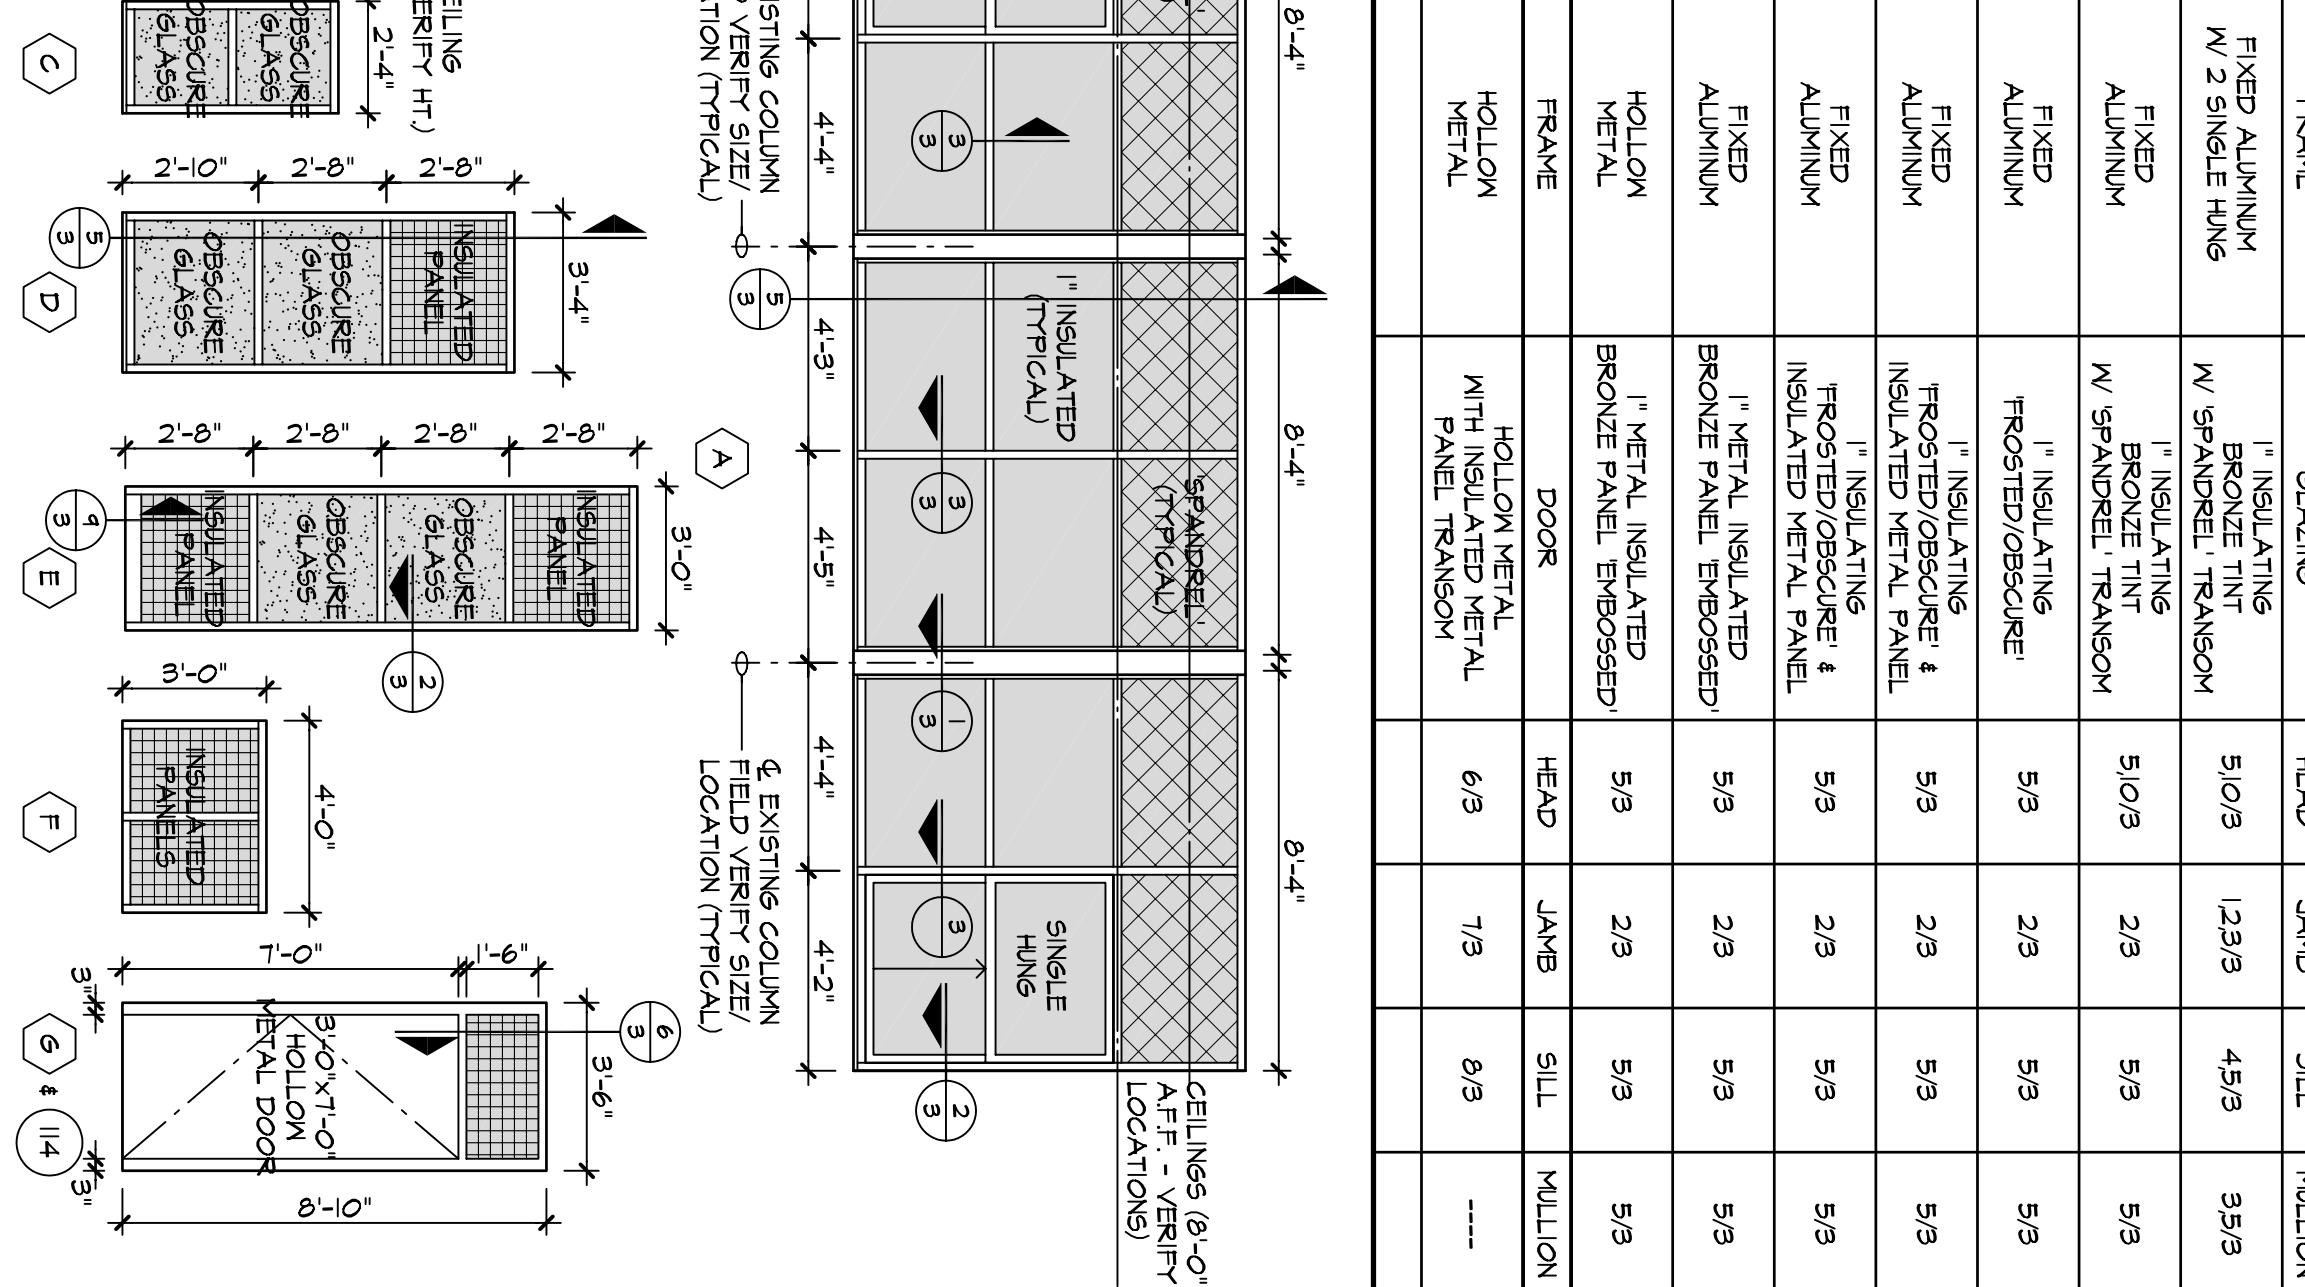

- NOTES:**
1. ALL NEW WINDOWS ARE TO BE INSTALLED WITHIN EXISTING MASONRY OPENINGS. CONTRACTOR SHALL FIELD VERIFY ALL CONDITIONS PRIOR TO BIDDING. (R.O. - TYP.) DIMENSIONS, CONDITIONS, MATERIALS, ETC. PRIOR TO BIDDING AND CONSTRUCTION.
 2. CONTRACTOR SHALL REMOVE ALL EXISTING WINDOWS AND RELATED COMPONENTS PRIOR TO NEW INSTALLATION.
 3. REPAIR ANY DAMAGE TO EXISTING OPENINGS AND ADJACENT SURFACES AS NECESSARY. MATCH EXISTING ADJACENT CONSTRUCTION AND FINISHES, TYPICAL.
 4. OPERABLE WINDOWS (B) TOTAL, SEE EXTERIOR ELEVATIONS FOR LOCATIONS MARKED BY (ARROW) SHALL PROVIDE A CLEAR SPACE OF 20" WIDE AND 24" HIGH IN THE OPEN POSITION WITH NO OBSTRUCTIONS CONTACT ARCHITECT WITH ANY CONDITIONS OR CONSTRAINTS PREVENTING THIS REQUIREMENT PRIOR TO FABRICATION OF WINDOWS, TYPICAL.
 5. ALL INSULATED GLAZING SHALL BE "1" THICK WITH BRONZE TINT. ALL INSULATED METAL PANELS SHALL BE "1" THICK. BRONZE TINT WITH BRONZE FINISH INTERIOR & EXTERIOR, TYPICAL. ALL RESTROOMS SHALL HAVE OBTUSCURE/FROSTED GLAZING. "1" INSULATED WITH THE OUTSIDE GLAZING TO BE BRONZE TINT AND THE INTERIOR TO BE OBTUSCURE/SWIFT SAMPLES FOR APPROVAL ON ALL FINISHES LISTED ABOVE.
 6. METAL STUD FRAMING, GYP BOARD, TEXTURE AND PAINT SHALL BE PROVIDED TO CONSTRUCT NEW BULKHEADS AT ALL WINDOW OPENINGS TO CONCEAL THE SPANDREL PANELS ABOVE EXISTING CEILING HEIGHTS. SEE SECTION FOR DETAILS, EXCLUDING CORRIDOR & OBTUSCURE/FROSTED WINDOWS.
 7. ALL EXISTING SUSPENDED CEILING SHALL BE MODIFIED AS NECESSARY FOR REMOVAL OF EXISTING WINDOWS AND INSTALLATION OF NEW WINDOWS. NOTIFY EXISTING CEILING AS NECESSARY FOR TERMINATING INTO NEW BULKHEADS ACROSS THESE OPENINGS. FIELD VERIFY ALL EXISTING CONDITIONS PRIOR TO BIDDING AND CONSTRUCTION.
 8. WINDOW BLINDS: CONTRACTOR SHALL PROVIDE AND INSTALL NEW HORIZONTAL WINDOW BLINDS FOR ALL NEW WINDOWS (EXCLUDING RESTROOMS, ROOMS (I) & (II)) SEE SPECIFICATIONS. HEIGHTS SHALL BE FROM THE NEW BULKHEAD TO THE EXISTING SILL. FIELD VERIFY ALL EXISTING OPENING SIZES PRIOR TO BIDDING & INSTALLATION. WINDOW 'A' SHALL HAVE 3 SECTIONS OF BLINDS EACH.
 9. WINDOW 'E' SHALL HAVE THE EXISTING DOOR FRAME GLAZING, FRAMING, ETC. REMOVED PRIOR TO INSTALLATION. REMOVE ANY ROTTEN OR DETERIORATED MATERIALS AND PREP OPENINGS FOR NEW ALUMINUM FRAMED WINDOWS, TYPICAL.
 10. DOOR (I), EXTERIOR ENTRY TO BASEMENT. SEE PLAN. SHALL HAVE THE EXISTING DOOR FRAME RELATED FRAMING, REMOVED AND REPLACE ANY ROTTEN AND/OR DETERIORATED WOOD AND OTHER FRAMING. PROVIDE AND INSTALL NEW HOLLOW METAL DOOR AND FRAME WITH INSULATED METAL PANEL FOR TRANSOM. PROVIDE AND INSTALL NEW HINGE, LOCKSET, CLOSER, THRESHOLD STOPS, WEATHERSTRIPPING, ETC. (SEE SPECIFICATIONS)

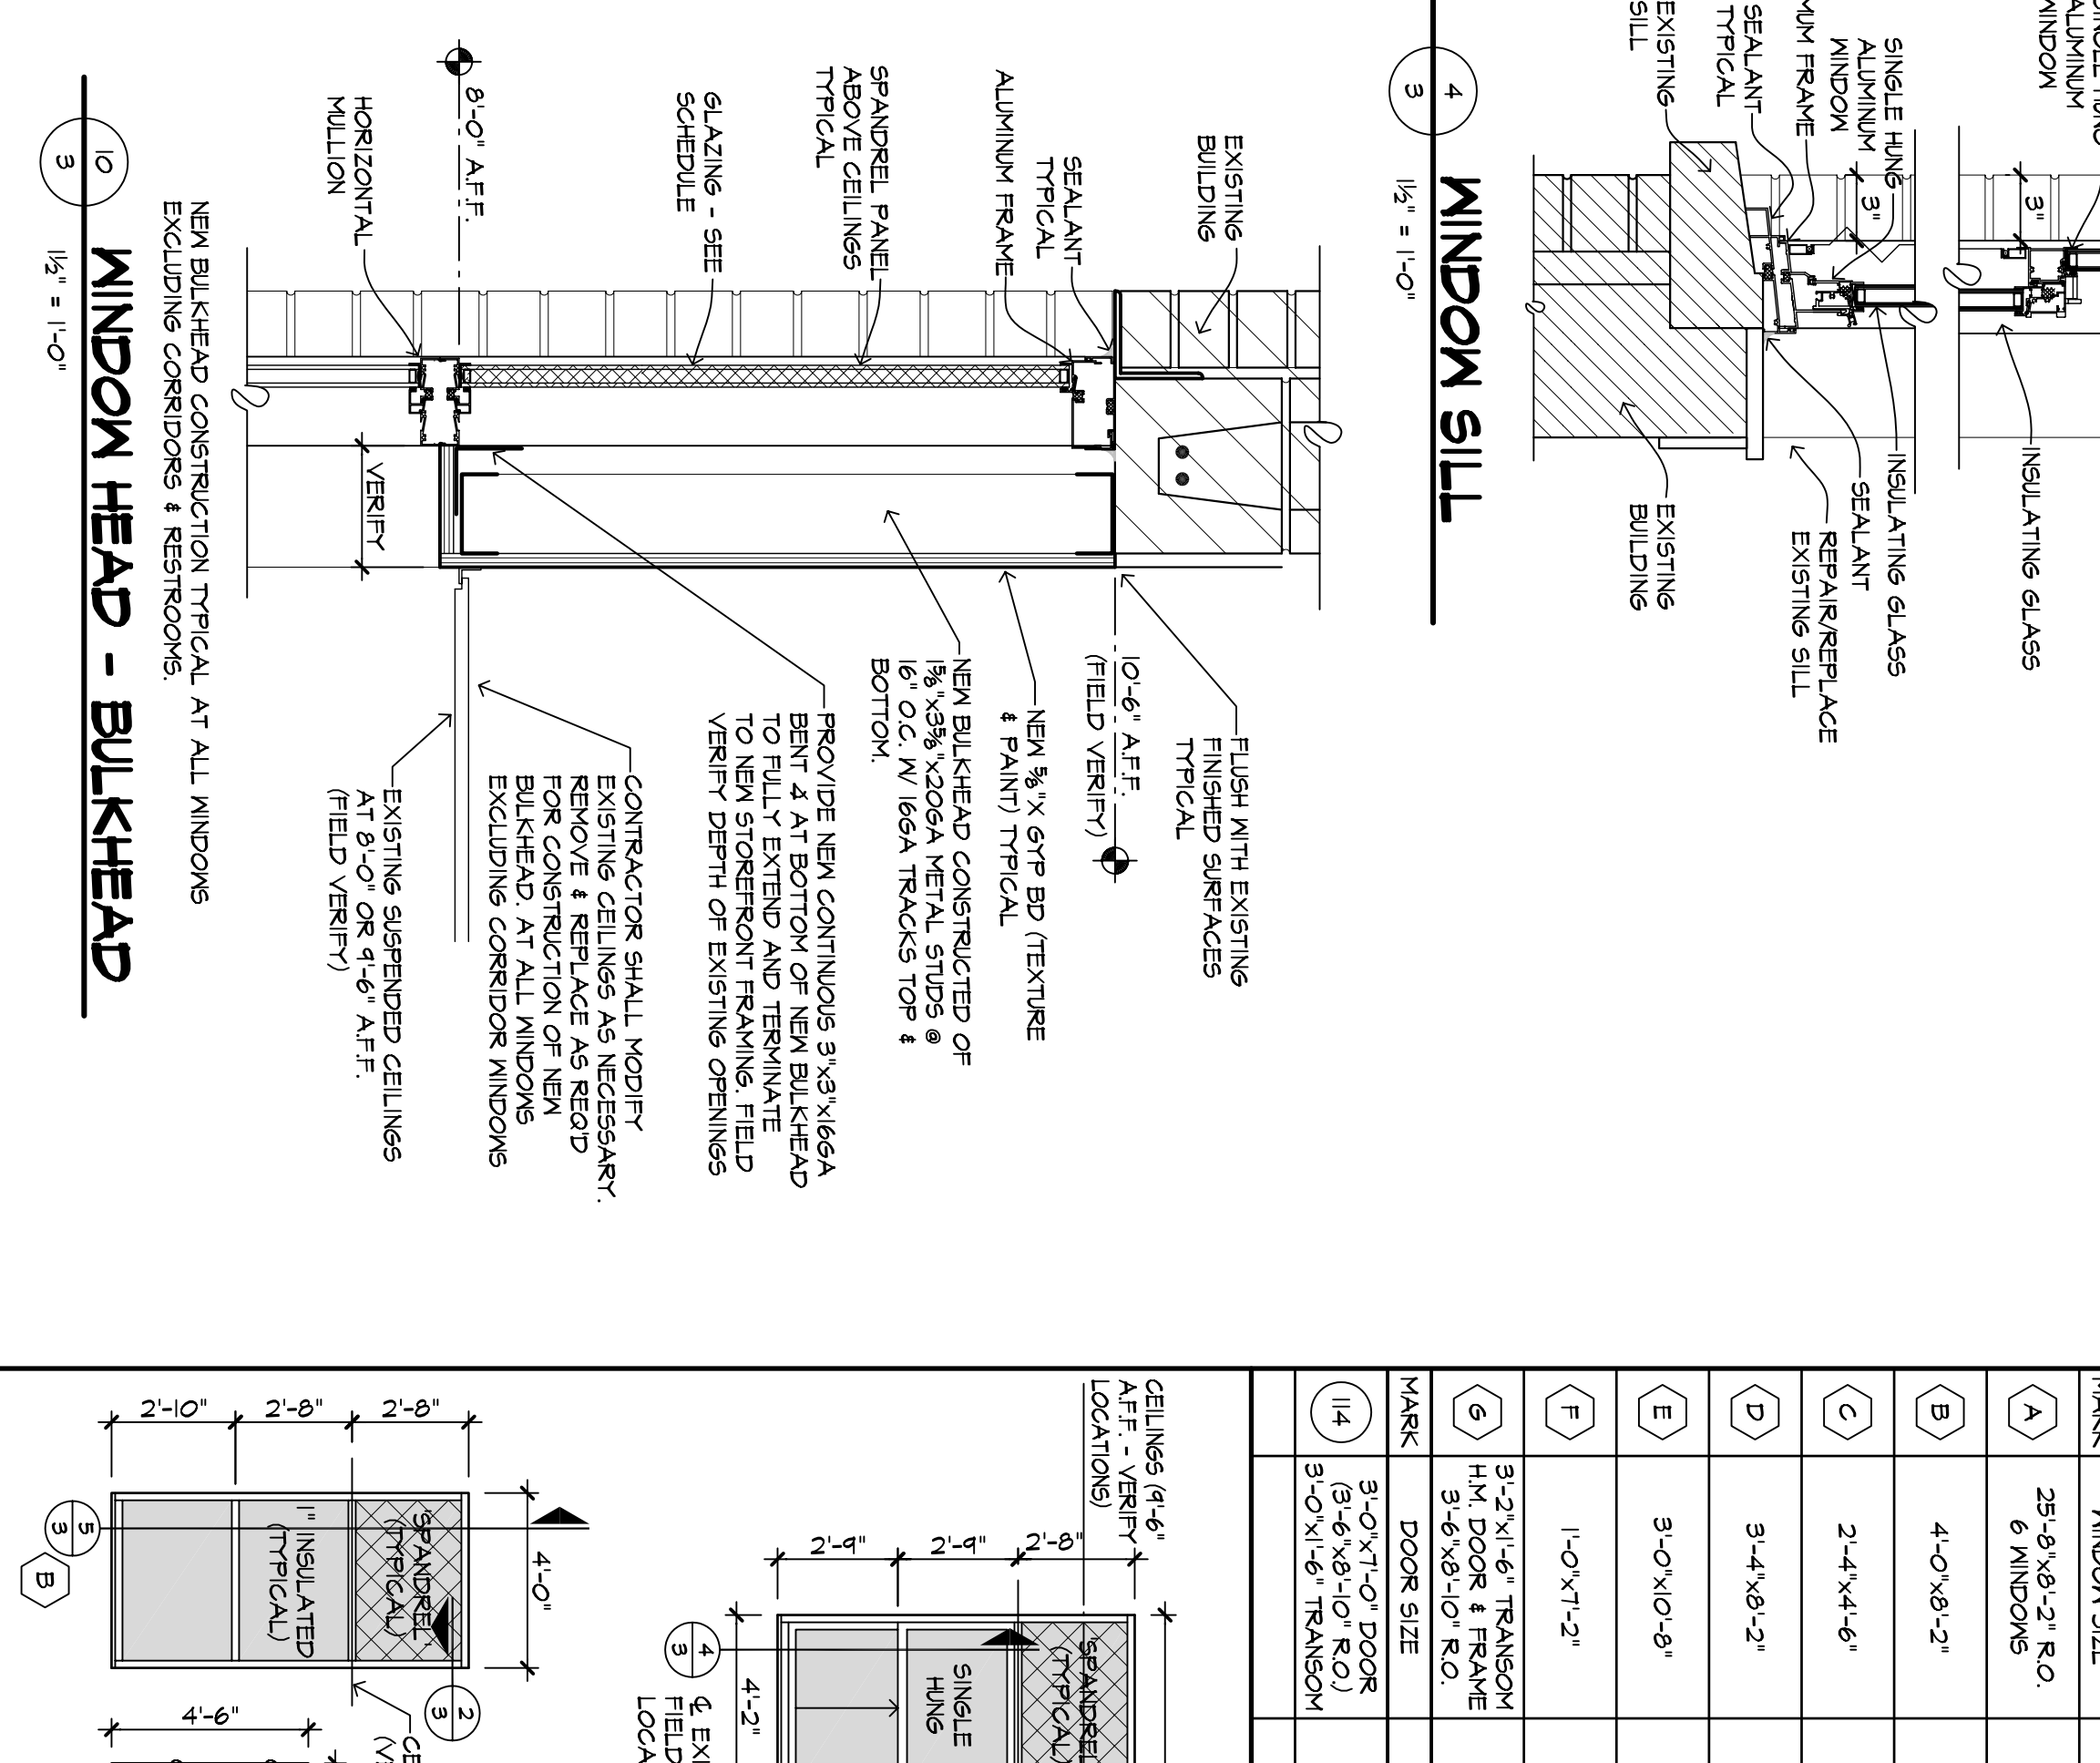